


# Grounding and Bonding Requirements At Main Distribution Panel

WH Energy

Per NEC® 250.52(A)(3) concrete-encased electrodes when a minimum 4 AWG rebar is used, the concrete-encased electrode shall be connected per NEC® 250.70 to a minimum 4 AWG copper conductor (NEC® 250.66(B)) back to the main distribution panel copper ground buss.

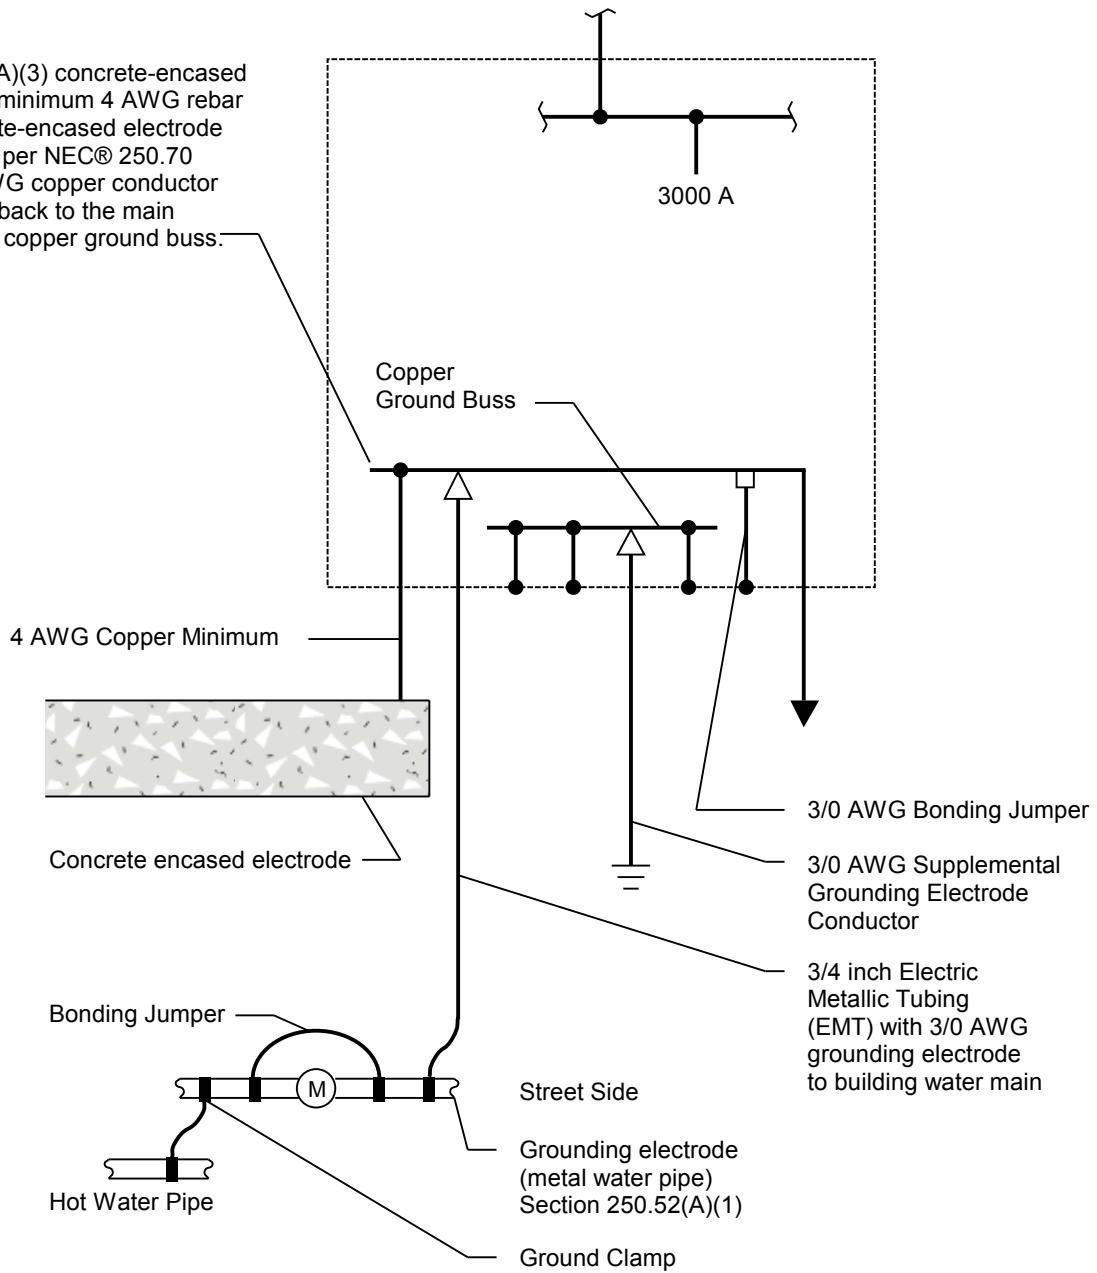

Project Name: <b>WH Energy</b>			
Drawing Title: <b>Grounding &amp; Bonding at MDP</b>			
<b>Dolphins Software</b> 10021 Prairie Dunes Way Sacramento, CA 95829 (916) 681-0513	Date: Monday, Jul. 03, 2006	Scale: None	Drawing Number:
	Project Number:	Drawn By: Dan Laws	