


Grounding and Bonding Requirements At Transformer #1

10 kVA - 1-Phase, 240 / 120V

- (2)- 6 ga. THHN, Cu conductors - Current
- (1)- 6 ga. THHN, Cu conductor - Neutral
- (1)- 8 ga. THHN, Cu conductor - Ground

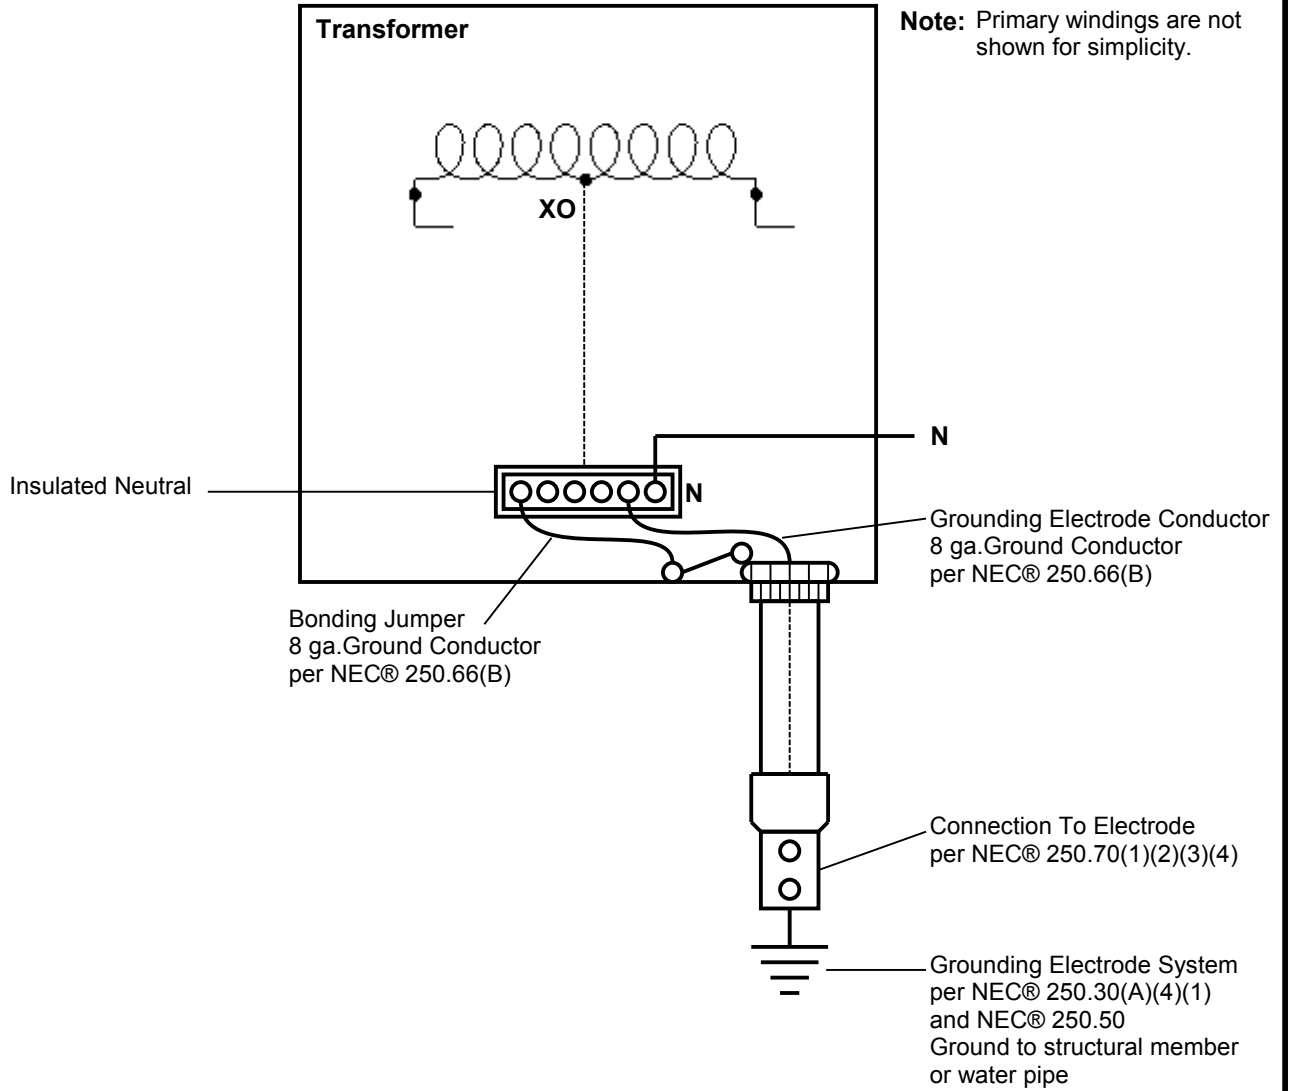

Project Name:			
Drawing Title: Transformer #1 Grounding & Bonding at MDP			
Dolphins Software 10021 Prairie Dunes Way Sacramento, CA 95829 (916) 681-0513	Date: Wednesday, Aug. 18, 2010 Project Number:	Scale: None Drawn By: Dan Laws	Drawing Number: