


Grounding and Bonding Requirements At Transformer #3

75 kVA - 3-Phase, 480 / 208V

- (3)- 1 ga. THHN, Cu conductors - Current
- (1)- 1 ga. THHN, Cu conductor - Neutral
- (1)- 1 ga. THHN, Cu conductor - Ground

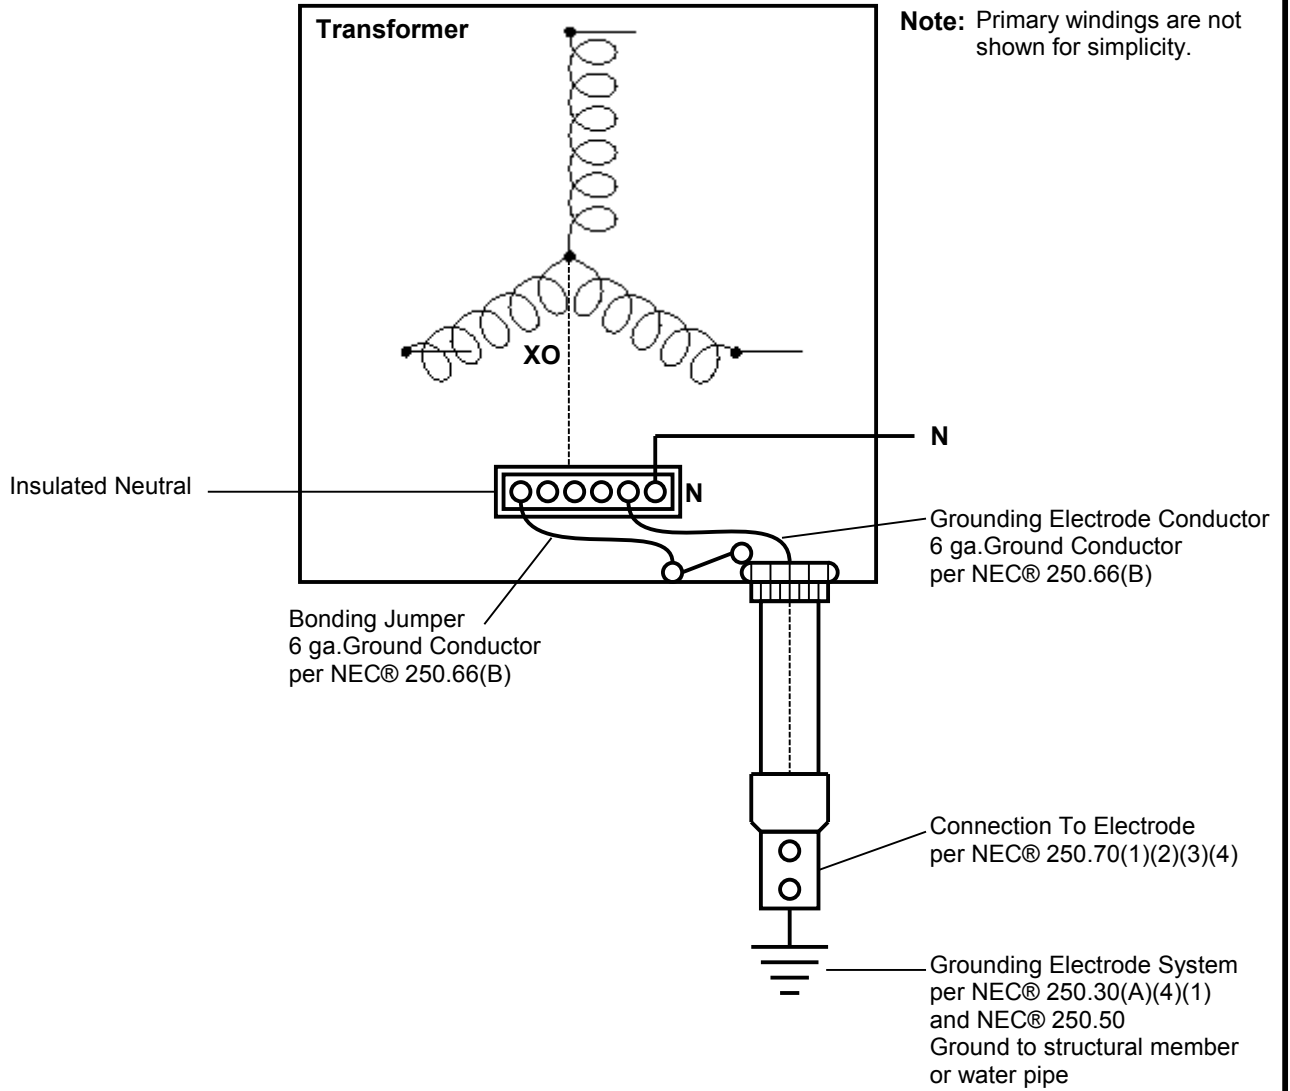

Project Name:			
Drawing Title: Transformer #3 Grounding & Bonding			
Dolphins Software 10021 Prairie Dunes Way Sacramento, CA 95829 (916) 681-0513	Date: Wednesday, Aug. 18, 2010	Scale: None	Drawing Number:
	Project Number:	Drawn By: Dan Laws	